



KARACHI WATER & SEWERAGE BOARD
OFFICE OF THE EXECUTIVE ENGINEER SEWS PUMPING DIV.

NO. E.E/SPD/WORKS/KW&SB/2015/0028

Dated: 03-02-2015

M/S.ASIF ENTERPIRSES.

WORK ORDER

SUBJECT: URGENT REPAIRING AND REWINDING OF (40HP) IMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II, LYARI) KW&SB

Consequent upon the submission of the formal acceptance of your side the Condition of Contract and Letter of Acceptance, you are here by directed to commence the work in strict accordance with the contract with shall be recount from the receipt of this letter and get completed within 10 Days.


Please acknowledge the receipt of the letter by signature in the space provided below.


EXECUTIVE ENGINEER)
SEW PUMP DIV.
(KW&SB)

Copy to:-

1. C.E (E&M SEW) KW&SB.
2. S.E LYARI KW&SB.
3. Budget Office, KW&SB.
4. Office Copy.

RECEIVED THE LETTER

Signature 
Name: M. Asif
Proprietor
Dated: 3-2-15

SINDH PUBLIC PROCUREMENT REGULATORY AUTHORITY

CONTRACT EVALUATION FORM

TO BE FILLED IN BY ALL, PROCURING AGENCIES FOR PUBLIC CONTRACTS OF WORKS, SERVICES & GOODS

- 1) NAME OF THE ORGANIZATION / DEPTT. KARACHI WATER & SEWAGE BOARD
- 2) PROVINCIAL / LOCAL GOVT / OTHER LOCAL GOVT
- 3) TITLE OF CONTRACT IMPROVE SEWAGE SYMTEM
- 4) TENDER NUMBER 01
- 5) BRIEF DESCRIPTION OF CONTRACT URGENT REPAIRING AND REWINDING OF (40HP) HMA
- 6) FORUM THAT APPROVED THE SCHEME SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL
- 7) TENDER ESTIMATED VALUE WORK INSTALLED AT TENNARY ROAD PUMPING PUMP
- 8) ENGINEER'S ESTIMATE NO.2 JUNA MASJID PUMPING STATION AND GHOSIA
(For civil works only) PUMPING STATION (SPD-II, LYARI) KW&SB
- 9) ESTIMATED COMPLETION PERIOD (AS PER CONTRACT) 90 DAYS
- 10) TENDER OPENED ON (DATE & TIME) 20/11/2014
- 11) NUMBER OF TENDER DOCUMENTS SOLD 02 NOS
(Attach list of buyers)
- 12) NUMBER OF BIDS RECEIVED 02 NOS
- 13) NUMBER OF BIDDERS PRESENT AT THE TIME OF OPENING OF BIDS 02 NO
- 14) BID EVALUATION REPORT YES
(Enclose a copy)
- 15) NAME AND ADDRESS OF THE SUCCESSFUL BIDDER M/S. ASIF ENTERPRISES
- 16) CONTRACT AWARD PRICE 998,193/-
- 17) RANKING OF SUCCESSFUL BIDDER IN EVALUATION REPORT
(i.e. 1st, 2nd, 3rd EVALUATION BID) 998193/-
999227/-

18) METHOD OF PROCUREMENT USED : - (Tick one)

- a) SINGLE STAGE - ONE ENVELOPE PROCEDURE Domestic/ Local
- b) SINGLE STAGE - TWO ENVELOPE PROCEDURE
- c) TWO STAGE BIDDING PROCEDURE
- d) TWO STAGE - TWO ENVELOPE BIDDING PROCEDURE

PLEASE SPECIFY IF ANY OTHER METHOD OF PROCUREMENT WAS ADOPTED i.e. EMERGENCY, DIRECT CONTRACTING ETC. WITH BRIEF REASONS:

19) APPROVING AUTHORITY FOR AWARD OF CONTRACT _____

20) WHETHER THE PROCUREMENT WAS INCLUDED IN ANNUAL PROCUREMENT PLAN?

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

21) ADVERTISEMENT :

i) SPPRA Website
(If yes, give date and SPPRA Identification No.)

Yes	
No	

ii) News Papers
(If yes, give names of newspapers and dates)

Yes	
No	

22) NATURE OF CONTRACT

Domestic	<input checked="" type="checkbox"/>	Int.	<input type="checkbox"/>
----------	-------------------------------------	------	--------------------------

23) WHETHER QUALIFICATION CRITERIA WAS INCLUDED IN BIDDING / TENDER DOCUMENTS?
(If yes, enclose a copy)

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

24) WHETHER BID EVALUATION CRITERIA WAS INCLUDED IN BIDDING / TENDER DOCUMENTS?
(If yes, enclose a copy)

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

25) WHETHER APPROVAL OF COMPETENT AUTHORITY WAS OBTAINED FOR USING A METHOD OTHER THAN OPEN COMPETITIVE BIDDING?

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

26) WAS BID SECURITY OBTAINED FROM ALL THE BIDDERS?

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

27) WHETHER THE SUCCESSFUL BID WAS LOWEST EVALUATED BID / BEST EVALUATED BID (in case of Consultancies)

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

28) WHETHER THE SUCCESSFUL BIDDER WAS TECHNICALLY COMPLIANT?

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

29) WHETHER NAMES OF THE BIDDERS AND THEIR QUOTED PRICES WERE READ OUT AT THE TIME OF OPENING OF BIDS?

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

30) WHETHER EVALUATION REPORT GIVEN TO BIDDERS BEFORE THE AWARD OF CONTRACT?
(Attach copy of the bid evaluation report)

Yes	<input type="checkbox"/>	No	<input checked="" type="checkbox"/>
-----	--------------------------	----	-------------------------------------

31) ANY COMPLAINTS RECEIVED
(If yes, result thereof)

Yes	
No	NO

32) ANY DEVIATION FROM SPECIFICATIONS GIVEN IN THE TENDER NOTICE / DOCUMENTS
(If yes, give details)

Yes	
No	NO

33) WAS THE EXTENSION MADE IN RESPONSE TIME?
(If yes, give reasons)

Yes	
No	NO

34) DEVIATION FROM QUALIFICATION CRITERIA
(If yes, give detailed reasons.)

Yes	
No	NO

35) WAS IT ASSURED BY THE PROCURING AGENCY THAT THE SELECTED FIRM IS NOT
BLACK LISTED?

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

36) WAS A VISIT MADE BY ANY OFFICER/OFFICIAL OF THE PROCURING AGENCY TO THE
SUPPLIER'S PREMISES IN CONNECTION WITH THE PROCUREMENT? IF SO, DETAILS TO
BE ASCERTAINED REGARDING FINANCING OF VISIT, IF ABROAD.
(If yes, enclose a copy)

Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

37) WERE PROPER SAFEGUARDS PROVIDED ON MOBILIZATION ADVANCE PAYMENT IN
THE CONTRACT (BANK GUARANTEE ETC.?)


Yes	<input checked="" type="checkbox"/>	No	<input type="checkbox"/>
-----	-------------------------------------	----	--------------------------

38) SPECIAL CONDITIONS, IF ANY
(If yes, give Brief Description)

Yes	
No	NO

39) Date of Award of Contract

Signature & Official Stamp of
Authorized Officer


Executive Engineer
Sewerage Pumping Division
Karachi Water & Sewerage Board

FOR OFFICE USE ONLY


SPPRA, Block, No.8, Sindh Secretariat No.4-A, Court Road, Karachi
Tele: 021-9205356; 021-9205369 & Fax: 021-9206291

Print

Save

Reset

3/3

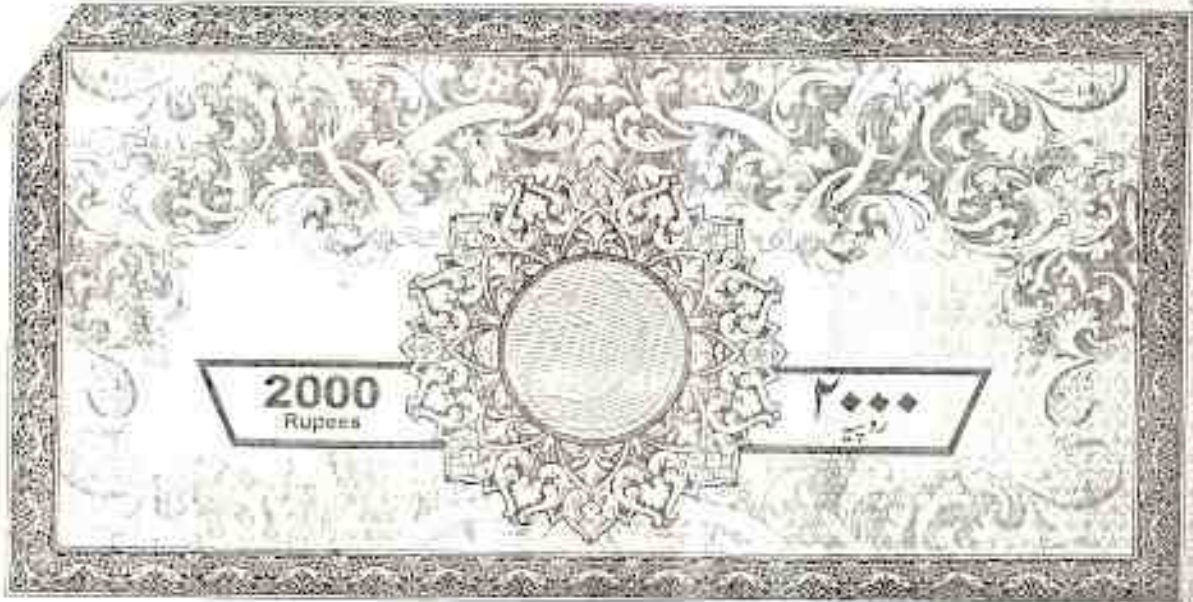

AAMIR ALI STAMP VENDOR CONTRACT AGREEMENT

Fig. No. A-E, Lawrence Road, Garden West, Karachi

Lic. No. 38 *26027*

S. No. _____
 DATE: 27/11/2015 This CONTRACT AGREEMENT made the _____ day of _____ 2015,

between the **Karachi Water & Sewerage Board (KW&SB)**, Government of Sindh, Represented by its Chief Engineer (S.W.C), KW&SB, (hereinafter called the "Employer" which expression shall wherever the context so admits or required be deemed to include their successor) on the one part as first Party


M/S. ASIF ENTERPRISES, having their office at **House No.12411, Behar Colony, Masjid Road, Lyari Karachi**, Represented by the **MR. GHULAM QADIR RAEES** hereinafter called the "Contractor" (which expression shall wherever the context so admit or required be deemed to include their Executors, Administrators, Successors and permitted Assignees) on other part as second party.

ISSUED TO WITH ADDRESS
 THROUGH WITH ADDRESS
 PURPOSE
 VALUE RS
 STAMP VENDOR SIGNATURE

WHEREAS the Employer is desirous to execute the work "URGENT REPAIRING AND REWINDING OF (40 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II), LYARI, KW&SB" Under **KARACHI WATER & SEWRAGED BOARD's Own Funds** and has accepted the Tender of the CONTRACTOR for **Rs.9,98,193/= (RUPEES NINE LACS NINETY EIGHT THOUSAND ONE HUNDRED NINETY THREE ONLY)**, for the construction and completion of such WORKS and the remedying of an defects therein. The tender was called upto through Authority's Website of SPPRA Rule-2010 under **Serial NO.21742**.

AND WHEREAS THE CONTRACTOR has already deposited 2% Performance Security for amounting to **Rs.20,000/=**, vide Pay Order No. **11730004**, dated **20-11-2014**, issued from **HBL- Atmaram Pritamdas Branch Karachi**, remaining 8% Performance Security for amounting to **Rs.79,819/=** will be deducted from your bill, the same will be kept with the EMPLOYER till the maintenance period of the work for the due fulfillment of the CONTRACT. Further 1% Water Charges will also be deducted from your bill as per Standard Operating Procedure (SOP).

(Handwritten signatures)

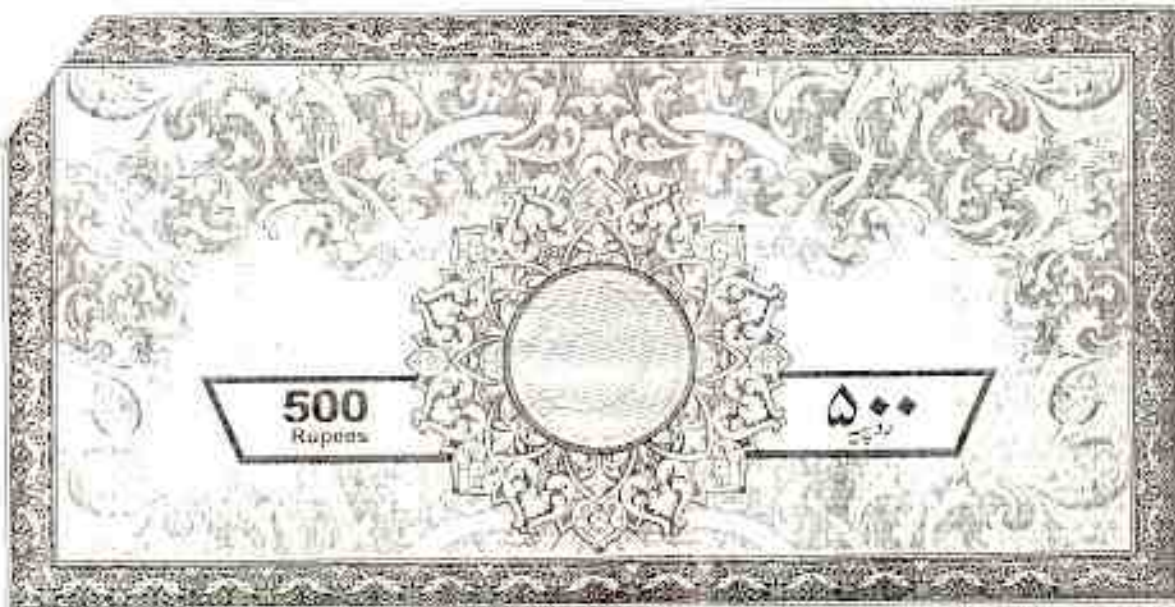

AAMIR ALI STAMP VENDOR

For the A.L.I. Stamp Vendor Photo Copy of this Agreement witnesses as follows:

Lot No: 36 Photo

S. No. 26 JAN 2015

Date: 26 JAN 2015

Stamp Vendor Signature

In this Agreement words and expression shall have the same meanings as are respectively assigned to them in the conditions of Contract hereinafter referred to.

The following documents which for the purpose of identification have been signed by **MR. GHULAM QADIR RAJES** on behalf of the contractor and by **MR. ABDUL RAHIM KHATTI, CHIEF ENGINEER (S.W.C.), KW&SB**, on behalf the EMPLOYER all of which shall be deemed to form and be read and construed as part of this Agreement.

- a). This Form of Agreement.
- b). Employer letter of Acceptance No. CE/SWC/DS/W&S/LOA/KW&SB/2015/16 dated: 02-02-2015.
- c). The Tender.
- d). The conditions of the Particular Application - Part-II-A & II-B.
- e). The General Conditions - Part-I.
- f). The Drawings.
- g). The specifications and
- h). The Priced Bill of Quantities.

3. In consideration of the payments to be made by the EMPLOYER to the CONTRACTOR, has hereinafter mentioned, the CONTRACTOR hereby covenants with the EMPLOYER to execute and complete the WORK and to remedy any defects therein and maintaining the same in conformity in all respects with the provisions of the CONTRACT.

4. THE EMPLOYER hereby covenants to pay to the CONTRACT in the manner prescribed by the CONTRACT.

(Signature)

(Signature)



AAMIR ALI STAMP VENDOR

In WITNESS WHEREOF, the parties hereto have set their respective hands and seals this 26th day of JAN 2019.

S. No. *1004*
C.T. No. *26 JAN 2019* Signed, Sealed and Delivered by the:

EMPLOYER'S SIGNATURE
EMPLOYER'S SEAL
EMPLOYER'S NAME
EMPLOYER'S ADDRESS
EMPLOYER'S CONTACT NO.

For and on behalf of
EMPLOYER

For and on behalf of
CONTRACTOR

[Signature]
ABDUL RAHIM KHATTI
CHIEF ENGINEER (S.W.C.)
KARACHI WATER & SEWERAGE BOARD

[Signature]
GHULAM QADIR RAJES
PROPRIETOR
M/S. ASIF ENTERPRISES.

WITNESS OF EMPLOYER

WITNESS OF CONTRACTOR

[Signature]
MUHAMMAD ARIF
SUPERINTENDING ENGINEER (SOUTH)
K.W.&S.B.

[Signature]
M/S. Asif Enterprises
[Signature]
M/S. Hameed Associates

[Signature]
KHALIL HOAT
EXECUTIVE ENGINEER (E&M-GEW)
SPD-II, LYARI TOWN, DISTRICT SOUTH
K.W.&S.B.

KARACHI WATER & SEWERAGE BOARD

OFFICE OF THE CHIEF ENGINEER (IP&D)

Refer

BID EVALUATION REPORT

Procuring Agency	KARACHI WATER & SEWERAGE BOARD
Reference No	SPPRA Serial No 21742 I.D No: /2014
Description/Name of Work	URGENT REPAIRING AND REWINDING OF (40 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO 2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-I), LYARI, KW&SB
Mode of Procurement	Single Stage (One Envelope)
Published	Through Web Site
Documents Sold	2 Nos
Documents Received	2 Nos
Bid Opening Date (if applicable)	N/A
Bid Technically Evaluated (if applicable)	N/A
Number of Bids	One
Bid Opening Date	20/11/2014

BIDDER OR BIDDER	COST OFFERED BY THE BIDDERS	RANKING IN TERMS OF COST	COMPARISON WITH ESTIMATED COST	REASON FOR ACCEPTANCE/ REJECTION	REMARKS
Asif Enterprises	Rs. 888,182/-	1st Lowest	@ 4.884% Above	Substantially Responsive	P.O # 11733004 Dt: 20/11/2014 Rs 20,000/- HBL Almaraj Transitions Br
UBL Contractors	Rs. 999,237/-	2nd Lowest	@ 5.102% Above	Unresponsive due to disqualification	P.O # 7261625 Dt: 18/11/2014 Rs 21,000/- UBL Chughtai Br

Interested bidders are being informed accordingly.

For compliance of rule 45 of SPPRA 2010 M/s. Asif Enterprises declared as the lowest responsive bidder and recommended for Sanction from Competent Authority.


Masood Nawaz Khan
Accounts Officer (South)
Member/Secretary


(Saif-ul-Haque)
Additional Director Internal
Audit - KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member


Muhammad Arif
Chief Engineer (South)
Member


(Abdul Fajim Khattak)
Chief Engineer (IPD)
(Convener)

COMPARATIVE STATEMENT

NAME OF WORK: URGENT REPAIRING AND REMOVING OF (SC-41) HIGH SUMMERABLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENGAIR ROAD PUMPING PUMP NO 2 JUNA MASJID PUMPING STATION AND OHODJA PUMPED STATION (SP-01), LYARI, KWASSI

S.No	Description of Work	Engineer's Estimate			M/s. Ashi Enterprises		M/s. A.H Enterprises	
		Quantity	Rate	Unit	Amount	Rate	Amount	
1	Re-welding of electrical motor 3 phase 60/440 volts 50 cycle with best quality insulator copper wire of required gauge including testing on site with satisfactory result up to one week's time (opening and testing and replacing bolts if necessary excluding the cost of work self material)	3.00 Nos	40,200.00	Pieces	120,600.00	42,000.00	126,000.00	
2	Disassembling and re-assembling of submerisible pump i/c transportation charges from site to work place and back	3.00 Job	11,012.00	Pieces	33,036.00	11,503.00	34,509.00	
3	Providing fixing O ring kit ternary pit pump no 2 Juna masjid pump no 2 and ghosia pit	3.00 Nos	3,000.00	Each	9,000.00	3,633.00	10,899.00	
4	Providing seal being electrical production twister ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	8,000.00	Each	24,000.00	8,400.00	25,200.00	
5	Providing base mechanical seal parts no. 3040357 ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	40,000.00	Each	120,000.00	100,000.00	120,000.00	
6	Providing base mechanical seal parts no. 8631400 ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	40,000.00	Each	120,000.00	42,000.00	126,000.00	
7	Providing washer parts no. 3021505 ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	570.00	Each	1,710.00	605.00	1,815.00	
8	Providing magnetic contactor model no. 10 S5 NC as required & as per instruction of ESI required ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	9,001.00	Each	27,003.00	9,750.00	29,250.00	
9	Providing magnetic contactor model no. 10 S5 NC as required & as per instruction of ESI required ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	13,075.00	Each	39,225.00	13,778.00	41,334.00	
10	Providing magnetic contactor model no. 10 S5 NC as required & as per instruction of ESI required ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	9,261.00	Each	27,783.00	10,724.00	32,507.00	
11	Providing magnetic contactor model no. 10 S5 NC as required & as per instruction of ESI required ternary pit pump no 2 Juna masjid pump no 2 & ghosia pit	3.00 Nos	25,541.00	Each	76,623.00	26,818.00	80,454.00	
					1,004,540.00	25,872.00	1,030,412.00	

Handwritten signature

Handwritten initials

Handwritten signature

NAME OF WORK: URGENT REPAIRING AND REWINDING OF 140 AMP 11KV SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARI ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD/II), CVRRI, KWASE

S No	Description of work	Engineer's Estimate				M/s. A.H Enterprises		M/s. A.H Enterprises	
		Quantity	Rate	Unit	Amount	Price	Amount	Rate	Amount
12	Fit rubber hose pipe 6 inches in pump battery pit pump no 2 juna masjid pump no. 2 & ghosia pit	105.00	150.00	Feet	15,750.00	1,267.00	126,730.00	1,200.00	126,945.00
13	Providing multi transformation voltage entry E.O.C.R 500 AMP battery pit pump no 2 juna masjid pump no. 2 & ghosia pit	1.00	3,500.00	Each	3,500.00	3,676.00	34,025.00	2,652.00	31,040.00
14	Providing phase failure relay no 25 ampere, governor, battery pit masjid pump no 2 juna masjid pump no. 2 & ghosia pit	2.00	11,000.00	Each	22,000.00	13,650.00	27,350.00	13,650.00	27,000.00
15	Fit chain pulley block 60 ton capacity with 16 meter chain complete in all weight (ulpano) battery pit pump no 2 juna masjid pump no. 2 & ghosia pit	2.00	55,000.00	Each	110,000.00	57,760.00	115,500.00	57,355.00	110,510.00
15	Buy	3.00	14,200.00	Each	42,600.00	34,015.00	44,730.00	14,574.00	44,747.00
					498,110.00	958,153.00	958,153.00	958,153.00	958,257.00
					990,713		998,193		999,217

Muhammad Nawaz Khan
 (Muhammad Nawaz Khan)
 Accounts Officer (South)
 Member/Secretary

Muhammad Aziz
 (Muhammad Aziz)
 Chief Engineer (South)
 Member

Saleemuddin
 (Saleemuddin)
 Additional Director Internal
 Audit - KMC Member

Mohd. Usman
 (Mohd. Usman)
 Chief Engineer (W.D. Services)

Muhammad Shabir
 (Muhammad Shabir)
 Superintending Engineer (KMC)
 Member

NAME OF WORK: URGENT REPAIRING AND REWINDING OF (40HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TERNARY ROAD PUMPING PUMP NO.2 JUNA MASHD PUMPING STATION AND GHOSHIA PUMPING STATION. (SPD-II, LYARI) KW&SB.

(b) Description and rate of item based on Market (offered Rates)

DESCRIPTION OF WORK / ITEM	QTY.	RATE		PER	AMOUNT
		Rate in Rupees	Rate in Words		
Rewinding of electrical motor, 3phase 20440 volts 20 cycle with best quality varnished copper wire of required gauge including testing on load with satisfactory result, up to one weeks time opening and refilling and replacing bolts if necessary including the cost of worn out material	40 HP 3 JOB	42294	Forty two thousand two hundred ninety four.	Per job	126882
Dismantling and re-assembling of submersible pump. V.e. importation charges from site to work hose pipe and back.	3 JOB	11563	Eleven thousand five hundred sixty three.	Each	34689
Providing fixing O Ring kit ternary p/s pump no. 2 / Juna mashd pump no. 3 and ghoshia P/s	03 NOS	3675	Three thousand six hundred seventy five.	Each	11025
Providing and fixing thermal protection switch ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia p/s	03 NOS	8400	Eight thousand four hundred.	Each	25200
Providing lower mechanical seal part no. 3940307 ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia P/s	03 NOS	42000	Forty two thousand.	Each	126000
Providing lower mechanical seal parts no. 6231400 ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	42000	Forty two thousand.	Each	126000
Providing washer parts, No. 9821500 ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	605	Six hundred five.	Each	1815
Magnetic contactor model no. FC 55 NC as required & as per instruction of E.O. required for ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	9766	Nine thousand seven hundred sixty six.	Each	29298
Magnetic contactor model no. E5 as required & as per instruction of E.O. required at panel board ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	13728	Thirteen thousand seven hundred twenty eight.	Each	82368
Protect barter 100 Amp TP (KS-1400 NS) on prepared board as required for ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	9724	Nine thousand seven hundred twenty four.	Each	29172
Arc fault breaker 200 amp (KS-225 NS) on prepared board as required for ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	26818	Twenty six thousand eight hundred eighteen.	Each	80454
1/2" rubber hose p/s 6" made in japan for ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	100 MTR	1207	One thousand two hundred seven.	MTR	126735
Rewinding multi fascination voltage relay E.G.C.R 170 AMP (1 amwah) ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	03 NOS	3675	Three thousand six hundred seventy five.	Each	11025
Providing phase failure relay no. 25 sahara german ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	02 NOS	13650	Thirteen thousand six hundred fifty.	Each	27300
100mm pushy block 05 ton capacity with 15 meter long complete in 24 metre (Japan) ternary P/s pump no. 2 / juna mashd pump no. 3 & ghoshia pumping is	02 NOS	57750	Fifty seven thousand seven hundred fifty.	Each	115500
Battery 12 volts 200 AH/15 27 pole (Exide) or its equivalent and as per need requirement one battery for each P/s & act as per requirement.	03 NOS	14910	Fourteen thousand nine hundred ten.	Each	44730
TOTAL					998193

20/11/14

EXECUTIVE ENGINEER (SPD-II)
KW&SB

Amount quoted amounting to 998193 (Nine Lac Ninety Eight thousand One Hundred Ninety Three only)

Signature of [Signature]
Address: [Address]

Date: 20/11/14 Current No: 0320-20/15/999

Rate Quote: 998,193/- Nine Lac ninety eight thousand one hundred ninety three only

4. Pay Order Amount: 173000/- Date: 20-11-14 No: 26300/15 HBL
 H.O. [Signature] (KMC)
 G.E. (KMC) [Signature] C.E. (KMC) [Signature] C.E. (KMC) [Signature]
 HBL
 Attached
 P/20/15



KARACHI WATER & SEWERAGE BOARD
OFFICE OF THE CHIEF ENGINEER (IP&D)


BID EVALUATION REPORT

1	Name of Procuring Agency	KARACHI WATER & SEWERAGE BOARD
2	Tender Reference No	SPPRA Serial No.21742 / D No. /2014
3	Tender Description/Name of Work/Item	URGENT REPAIRING AND REWINDING OF (40 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II), LYARI, KW&SB
4	Method of Procurement	Single Stage (One Envelope)
5	Tender Published	Through Web Site
6	Total Bid Documents Sold	2 Nos
7	Total Bid Received	2 Nos
8	Technical Bid Opening Date (if applicable)	N/A
9	No. of Bid Technically Qualified (if applicable)	N/A
10	Bid (s) rejected	One
11	Financial Bid Opening Date	20/11/2014

S#	NAME OF FIRM OR BIDDER	COST OFFERED BY THE BIDDERS	RANKING IN TERMS OF COST	COMPARISON WITH ESTIMATED COST	REASON FOR ACCEPTANCE/ REJECTION	REMARKS
1	M/s. Asif Enterprises	Rs. 999,493/-	1st Lowest	@ 4.954% Above	Substantially Responsive	P.O # 11730064 Dt: 20/11/2014 Rs. 20,000/- HBL Amanatpur/Faridkot Br.
2	M/s. A H Enterprises	Rs. 999,237/-	2nd Lowest	@ 5.103% Above	unresponsive due to disqualified	P.O # 7251822 Dt: 18/11/2014 Rs. 21,000/- UBL Chakrawa Br.

The all concerned bidder are being informed accordingly.

The E E Concerned for compliance of rule 45 of SPPRA 2010 M/s. Asif Enterprises declared as the lowest responsive bidder by the Committee and recommended for Sanction from Competent Authority.


(Muhammad Nawaz Khan)
Accounts Officer (South)
Member/Secretary


(Saif-ul-Haque)
Additional Director Internal
Audit - KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member


(Muhammad Arif)
Chief Engineer (South)
Member


(Abdul Rahim Khattai)
Chief Engineer (IPD),
(Convener)

NIT Sr. No. 21742

Method of Procurement: Single Stage Single Envelope.

Name of Work: URGENT REPAIRING AND REWINDING OF (40 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II), LYARI, KW&SB

MINUTES OF BID OPENING MEETING.

A meeting of the procurement committee of this department was held on 20-11-2014 for opening the bids received in respect of subject NIT till deadlines of submission. The meeting was attended by all / following members of the procurement committee and the representative of bidders. (Attendance sheet is enclosed).

2. Two bidders submitted their bids till the deadline of submission.

- i. M/s. Asif Enterprises
- ii. M/s. A.H Enterprises

3. The bids were opened at 2:30 P.M in the presence of the above mentioned participants and the rates quoted by bidders were read aloud and encircled by Chairman of the Procurement Committee.


No	Name of Firm	Quoted Price	Amount of Bid Security	Pay Order No. / Date
01	M/s. Asif Enterprises	Rs. 998,193/-	Rs. 20,000/-	P.O # 11730004 Dt: 20/11/2014 HBL Atmaram Prtamdas Br
02	M/s. A.H Enterprises	Rs. 999,237/-	Rs. 21,000/-	P.O # 7251822 Dt: 18/11/2014 UBL Chakiwara Br

4. The bids do not contain any over-writing or cutting.

5. The committee shall examine all the bids as per the qualification / eligibility criteria provided in the bidding document and verify the documents and bid security submitted by the bidders (if required).

The meeting ended with the vote of thanks to and from the chair.


(Muhammad Nawaz Khan)
Accounts Officer (South)
Member / Secretary


(Muhammad Arif)
Chief Engineer (South)
Member


(Saif-ul-Haque)
Additional Director Internal
Audit - KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member

(Abul Raheem Khattai)
Chief Engineer (IPD)
Convener

NIT NO. 21742

Method and procedure of procurement: Open Competitive Bidding (National/ International Competitive Bidding) (Single Stage – One Envelope)

Description of work: URGENT REPAIRING AND REWINDING OF (40 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II), LYARI, KW&SB


Name of Bidder: M/s. Asif Enterprises

BIDDERS' ELIGIBILITY/ QUALIFICATION REPORT

Eligibility/ Qualification Criteria:

S. No.	Eligibility / Qualification Criteria	Bidders' name M/s. Asif Enterprises
1.	Registration with PEC (if applicable)	N/A
2.	NTN	Yes
3.	Sales Tax Registration	N/A
4.	Professional Tax	Yes
5.	Registration with Sindh Revenue Board (SRB)	N/A
Qualification Criteria:		
6.	Minimum three years' experience of relevant field.	Yes
7.	Turnover of at least last three years	Yes
8.	Required Bid Security is attached.	Yes
9.	Bid is signed, named and stamped by the authorized person of the firm along with Authorization letter.	Yes
10.	Any other factor deemed to be relevant by the procuring agency subject to provision of Rule-44	N/A
11.	Qualified/ disqualified	Qualified

Note: The procuring agency may modify the criteria as per their requirements.


(Muhammad Nawaz Khan)
Accounts Officer (South)
Member / Secretary


(Saif-ul-Haque)
Additional Director Internal
Audit – KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member


(Muhammad Arif)
Chief Engineer (South)
Member


(Abdul Raheem Khatt)
Chief Engineer (IPD)
Convener

NIT NO. 21742

Method and procedure of procurement: Open Competitive Bidding (National/ International Competitive Bidding) (Single Stage – One Envelope)

Description of work: URGENT REPAIRING AND REWINDING OF (40 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II), LYARI, KW&SB


Name of Bidder: M/s. A.H Enterprises

BIDDERS' ELIGIBILITY/ QUALIFICATION REPORT


Eligibility/ Qualification Criteria:

S. No.	Eligibility / Qualification Criteria	Bidders' name M/s. A.H Enterprises
1.	Registration with PEC (if applicable)	No
2.	NTN	No
3.	Sales Tax Registration	N/A
4.	Professional Tax	No
5.	Registration with Sindh Revenue Board (SRB)	N/A
	Qualification Criteria:	
6.	Minimum three years' experience of relevant field.	No
7.	Turnover of at least last three years	No
8.	Required Bid Security is attached.	No
9.	Bid is signed, named and stamped by the authorized person of the firm along with Authorization letter.	Yes
10.	Any other factor deemed to be relevant by the procuring agency subject to provision of Rule-44	N/A
11.	Qualified/ disqualified	Disqualified


Note: The procuring agency may modify the criteria as per their requirements.


(Muhammad Nawaz Khan)
Accounts Officer (South)
Member / Secretary


(Saif-ul-Haque)
Additional Director Internal
Audit – KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member


(Muhammad Arif)
Chief Engineer (South)
Member


(Abdul Kheem Khatt)
Chief Engineer (IPD)
Convener

COMPARATIVE STATEMENT
 NAME OF WORK: URGENT REPAIRING AND REMOVING OF (60 HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL, MECHANICAL WORK INSTALLED AT TENHARY ROAD PUMPING PUMP
 NO. 2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPO-III, LYARI, ANKSB)

S.No	Description of Work	Engineer's Estimate				M/s. Asif Enterprises		M/s. A.H Enterprises	
		Quantity	Rate	Unit	Amount	Rate	Amount	Rate	Amount
1	Rewinding of Electrical motor 3 phase 00440 volts 50 cycle with best quality insulated copper wire of required gauge including testing on load with satisfactory result up to one week's time opening and refilling and replacing bolts if necessary excluding the cost of worn out material	3.00 Job	40,260.00	P/Job	120,840.00	42,294.00	126,882.00	42,300.00	126,900.00
2	Deteriorating and re-assembly of submersible pump i/c transportation charges from site to work these pipe and back	3.00 Job	11,012.00	P/Job	33,036.00	11,561.00	34,685.00	11,568.00	34,704.00
3	Providing fixing 0 ring at ternary p/s pump no 2 / juna masjid pump no 3 and ghosia P/s	3.00 Nos	3,500.00	Each	10,500.00	3,675.00	11,025.00	3,675.00	11,037.00
4	Providing and fixing thermal production switch ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	3.00 Nos	8,000.00	Each	24,000.00	8,400.00	25,200.00	8,407.00	25,206.00
5	Providing lower mechanical seal parts no. 3540367 ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	3.00 Nos	40,000.00	Each	120,000.00	42,000.00	126,000.00	42,110.00	126,330.00
5	Providing tower mechanical seal parts no. 683 1400 ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	0.00 Nos	40,000.00	Each	120,000.00	42,000.00	126,000.00	42,110.00	126,330.00
7	Providing washer parts no. 3921 500 ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	3.00 Nos	676.00	Each	1,728.00	605.00	1,815.00	608.00	1,827.00
8	P/s magnetic contactor model no. 1c 65 NC as required & as per instruction of E/I require ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	3.00 Nos	9,303.00	Each	27,903.00	9,765.00	29,295.00	9,770.00	29,310.00
9	P/s magnetic contactor model no. 1c 65 NC as required & as per instruction of E/I required at panel board ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	8.00 Nos	13,075.00	Each	78,450.00	13,178.00	82,368.00	13,230.00	82,380.00
10	P/s circuit breaker 100 Amp TP (ss-1420 NSI) on prepared board as required ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	3.00 Nos	9,261.00	Each	27,783.00	9,734.00	29,172.00	9,730.00	29,190.00
11	required ternary p/s pump no 2 juna masjid pump no 3 & ghosia p/s	3.00 Nos	25,641.00	Each	76,923.00	26,018.00	80,454.00	26,022.00	80,460.00

Handwritten notes:
 2/21/11
 2/21/11
 2/21/11
 2/21/11
 2/21/11

Handwritten signatures:
 [Signature]
 [Signature]

NAME OF WORK: URGENT REPAIRING AND REWINDING OF 140 HP HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORK INSTALLED AT TENNARY ROAD PUMPING PUMP
NO 2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION (SPD-II, I, YARI, KWASB)

S.No	Description of Work	Engineer's Estimate				Min. Asif Enterprises		Min. A.H Enterprises	
		Quantity	Rate	Unit	Amount	Rate	Amount	Rate	Amount
12	PVC rubber hose pipe 6 made in japan ternary p/s pump no.2 juna Masjid Pump no. 3 & ghosia p/s.	105.00	RM	1,150.00	120,750.00	1,207.00	126,735.00	1,209.00	126,945.00
13	Providing multi levelation voltage relay E.O.C.R 5770 AMP (germany) ternary p/s pump no.2 juna masjid pump no. 3 & ghosia p/s.	3.00	Nos	3,500.00	10,500.00	3,675.00	11,025.00	3,680.00	11,040.00
14	Providing phase failure relay rs+25 zafura germany ternary p/s pump no.2 juna masjid pump no. 3 & ghosia p/s	2.00	Nos	13,000.00	26,000.00	13,650.00	27,300.00	13,680.00	27,320.00
15	PVC chain pulley block 08 ton capacity with 15 roller chain complete in all respect (Japan) ternary p/s pump no.2 juna masjid pump no. 3 & ghosia p/s.	2.00	Nos	55,000.00	110,000.00	57,750.00	115,500.00	57,755.00	115,510.00
15	Battery 12 bolts 200 AH/PS 27 plate (F-aido) or it sr equivalent and 88 per side requirement one battery for 08 p/s & u/c/s generator	3.00	Nos	14,200.00	42,600.00	14,910.00	44,730.00	14,914.00	44,742.00
	Say				990,713.00		998,193.00		999,237.00


(Munahmad Nwaz Khan)
Accounts Officer (South)
Member/Secretary


(Mubhammad Arif)
Chief Engineer (South)
Member


(Saif-ul-Haque)
Additional Director (Internal
Audit) - KMC Member


(Abdu Rashid Khan)
Chief Engineer (IPD) (Densher)


(Magsood Ahmed Sheer)
Superintending Engineer (KMC)
Member



KARACHI WATER & SEWERAGE BOARD
ATTENDANCE SHEET OF CONTRACTORS

NAME OF WORK : **URGENT REPAIRING AND REWINDING OF (40HP) HMA SUBMERSIBLE PUMP AND ELECTRICAL MECHANICAL WORKS INSTALLED AT TENNARY ROAD PUMPING PUMP NO.2 JUNA MASJID PUMPING STATION AND GHOSIA PUMPING STATION, SPD-II, LYARI TOWN.**

1. DATE OF OPENING & TIME: 20-11-2014 2.30 PM

2. ESTIMATED COST: RS.9,50,713/-

3. SERIAL # SERIAL NO.21742.

S.NO	NAME OF FIRM	NAME OF REPRESENTATIVES & DESIGNATION	SIGNATURE
1	M.S. ASIF ENTER	GHULM ELD R. RAEEB	
2	M/S AH Enterprise	Abdul Hafiz Soomro	
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			