

**SINDH PUBLIC PROCUREMENT REGULATORY AUTHORITY
 CONTRACT EVALUATION FORM
 TO BE FAILED BY ALL PROCURING AGENCIES FOR PUBLIC CONTRACTS OF WORKS
SERVICES & GOODS**

1	NAME OF THE ORGANIZATION/ DEPTT	KARACHI WATER & SEWERAGE BOARD
2	PROVINCIAL / LOCAL GOVT/OTHER	
3	TITLE OF CONTRACT	P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN
4	TENDER NUMBER	SPPRA SR. NO.35399
5	BREIF DESCRIPTION OF CONTRACT	Improvement of Water System at Baldia Town
6	FORUM THAT APPROVED THE SCHEME	MD, KW&SB
7	TENDER ESTIMATED VALUE	Rs.939668/-
8	ENGINEER'S ESTIMATE (Attach list of buyers)	Rs.939668/-
9	ESTIMATED COMPLETION PERIOD (As Per Contract)	25 Days
10	TENDER OPENED ON (DATE & TIME)	14-12-2017
11	NUMBER OF TENDER DOCUMENT SOLD (Attach list of Buyers)	Nos.
12	NUMBER OF BIDS RECEIVED	Nos.
13	NUMBER OF BIDDERS PRESENT AT THE TIME OF OPENING OF BIDS	Nos.
14	BID EVALUATION REPORT(enclose copy)	Attached
15	NAME AND ADDRESS OF THE SUCSESFUL BIDDER	M/S. S.O.H CONSTRUCTION CO. KARACHI
16	CONTRACT AWARD PRICE	Rs.939668/-

17 RANKING OF SUCCESSFUL BIDDER IN EVALUATION REPORT (i.e. 1st, 2nd, 3rd Evaluation bid)

2nd Lowest
3rd Lowest

18 METHOD OF PROCUREMENT USED (Tick one)

- a) Single Stage one Envelope Procedure _____ ✓
- b) Single Stage Two Envelope Procedure _____
- c) Two Stage Bidding Procedure _____
- d) Two Stage Two Envelope Bidding Procedure _____

Domestic /Local

19 APPROVING AUTHORITY FOR AWARD OF CONTRACT

20 WHETHER THE PROCUREMENT WAS INCLUDED IN ANNUAL PROCUREMENT PLAN?

YES	✓	NO	
-----	---	----	--

21 ADVERTISEMENT:

i) SPPRS Website
(if yes, give date and SPPRA's tender number)

YES	✓	
No		

News Papers

ii) Yes give names of newspapers and dates)

YES		THROUGH WEBSITE
No	✓	

22 NATURE OF CONTRACT

LOCAL	✓	INT.	
-------	---	------	--

23 WHETHER QUALIFICATION CRITERIA WAS INCLUDED IN BIDDING TENDER DOCUMENT ?
(if yes, enclose of copy)

YES		NO	✓
-----	--	----	---

24. WHETHER EVALUATION CRITERIA BID WAS INCLUDED IN BIDDING TENDER DOCUMENT ?
(if yes, enclose of copy)

YES		NO	✓
-----	--	----	---

25. WHETHER APPROVAL OF COMPETENT AUTHORITY WAS OBTAINED FOR USING A METHOD OTHER THAN OPEN COMPETITIVE BIDDING?

YES	✓	NO	
-----	---	----	--

26. WAS BID SECURITY OBTAINED FROM ALL THE BIDDERS?

YES	✓	NO	
-----	---	----	--

27. WHETHER THE SUCCESSFUL BID WAS LOWEST EVALUATED BID /BEST EVALUATED BID (in case of Consultancies)

YES	✓	NO	
-----	---	----	--

28. WHETHER THE SUCCESSFUL BIDDER WAS TECHNICALLY COMPLAINT

YES	✓	NO	
-----	---	----	--

29. WHETHER NAME OF HE BIDDERS AND THEIR QUOTED PRICE WERE REAS OUT AT THE TIME OF OPENING OF BIDS?

YES	✓	NO	
-----	---	----	--

30. WHETHER COPY OF EVALUATION REPORT GIVEN TO ALL BIDDERS?

YES	✓	NO	
-----	---	----	--

31. ANY COMPLAINTS RECEIVED
(if yes , result thereof)

YES	
No	✓

32. ANY DEVIATION FROM SPECIFICATION GIVEN IN THE TNER NOTICE / DOCUMENT
(if yes, give details)

YES	
No	✓

33. WAS THE EXTENTION MADE IN RESPONSE TIME?
(if yes, give details reasons).

YES	
No	✓

34. DEVIATION FROM QUALIFICATION CRITERIA
(if yes , give detailed reasons)

YES	
No	✓

35. WAS IT ASSURED BY THE PROCURING AGENCY THAT THE SELECTED FIRM IS NOT BLACK LISTED?

YES	✓	NO	
-----	---	----	--

36 WAS A VISIT MADE BY ANY OFFICER/OFFICIAL OF THE PROCURING AGENCY TO THE SUPPLIER PREMISES IN CONNECTION WITH THE PROCUREMENT? IF SO. DETAILED TO BE ASCERTAINED REGARDING FINANCING OF VISIT, OF ABROAD.
(if yes, enclose a copy)

YES		NO	<input checked="" type="checkbox"/>
-----	--	----	-------------------------------------

37 WERE PROPER SAFEGAURDS PROVIDED ON MOBILIZATION ADVANCE PAYMENT IN THE CONTRACT (BANK GUARANTEE ETC).

YES		NO	<input checked="" type="checkbox"/>
-----	--	----	-------------------------------------

38 SPECIAL CONDITION IF ANY.
(if yes. give brief description)

YES		
No	<input checked="" type="checkbox"/>	

Signature of Official Stamp of

Authorized Officer

~~EXECUTIVE ENGINEER~~

KH/33.B.

FOR OFFICE USE ONLY

SPPRA Block- No. 8, Sindh Secretariat no. 4-A, Court Road, Karachi
Tele: 0219205356, 021-9205369 & Fax 021-9206291

SPPRA

10. SPPRA Serial No.35399

and procedure of procurement: Open Competitive Bidding (National/ International Competitive Bidding) (Single Stage-One Envelope)

Refer


on of work: P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN

Opening: 14-12-2017 ✓


BIDDERS' ELIGIBILITY/ QUALIFICATION REPORT


Eligibility/ Qualification Criteria:


Eligibility / Qualification Criteria	Bidders' Name	
	M/s.S.O.H Construction Co.	M/s.Al-Maqbool Associates
Registration with PEC (if applicable)	N/A	N/A
NTN	Yes	Yes
Sales Tax Registration (FBR)	N/A	N/A
Registration with Sindh Revenue Board (SRB)	Yes	Yes
Qualification Criteria:		
5. Minimum three years' experience of relevant field.	Yes	Yes
6. Turnover of at least last three years	Yes	Yes
7. Required Bid Security is attached.	Yes	Yes
8. Bid is signed, named and stamped by the authorized person of the firm along with Authorization letter.	Yes	Yes
9. Any other factor deemed to be relevant by the procuring agency subject to provision of Rule-44	N/A	N/A
10. Qualified/ disqualified	Qualified	Qualified


(Muhammad Khalid Khan)
Accounts Officer (Dist. West)
Member / Secretary


(Saif-ul-Haque)
Additional Director Internal
Audit - KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member


(Muhammad Ali Shaikh)
S.E (District West-B)
Member


(Saifuddin)
Director (Design & Estimate)
Convener

No. SPPRA Serial No.35399

of Procurement: Single Stage Single Envelope.

Work: P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN

MINUTES OF BID OPENING MEETING.

A meeting of the procurement committee of this department was held on 14-12-2017 for opening the bids received in respect of subject NIT till deadlines of submission. The meeting was attended by all / following members of the procurement committee and the representative of bidders.

(Attendance sheet is enclosed).

Two bidders submitted their bids till the deadline of submission.

- i. M/s. S.O.H Construction Co.
- ii. M/s. Al-Maqbool Associates

The bids were opened at 2:30 P.M in the presence of the above mentioned participants and the rates quoted by bidders were read aloud and encircled by Chairman of the Procurement Committee.

Name of Firm	Quoted Price	Amount of Bid Security	Pay Order No. / Date
M/s.S.O.H Construction Co.	Rs.9,39,668/-	Rs.20,000/-	P.O # 18534904 dt:11-12-2017 from HBL Rizvia Society Branch Karachi
M/s.Al-Maqbool Associates	Rs.9,50,005/-	Rs.20,000/-	P.O # 18534922 dt:12-12-2017 from HBL Rizvia Society Branch Karachi

4. The bids do not contain any cutting or over-writing.
5. The committee shall examine all the bids as per the qualification / eligibility criteria provided in the bidding document and verify the documents and bid security submitted by the bidders (if required).


The meeting ended with the vote of thanks to and from the chair.



(Muhammad Khalid Khan)
Accounts Officer (Dist. West)
Member / Secretary




(Saif-ul-Haque)
Additional Director Internal
Audit - KMC Member



(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member



(Muhammad Ali Shaikh)
S.E (District West-B)
Member



(Saifuddin)
Director (Design & Estimate)
Convener

KARACHI WATER & SEWERAGE BOARD

OFFICE OF THE DIRECTOR (DESIGN & ESTIMATE)

BID EVALUATION REPORT


1	Name of Procuring Agency:	KARACHI WATER & SEWERAGE BOARD
2	Tender Reference No:	SPPRA Serial No.35399 I.D No. _____
3	Tender Description/Name of Work/Item:	P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN
4	Method of Procurement:	<u>Single Stage (One Envelop)</u>
5	Tender Published:	<u>Through SPPRA Web Site</u>
6	Total Bid Documents Sold:	<u>2 Nos</u>
7	Total Bid Received:	<u>2 Nos</u>
8	Technical Bid Opening Date (if applicable):	<u>N/A</u>
9	No. of Bid Technically Qualified (if applicable)	<u>N/A</u>
10	Bid (s) Rejected:	<u>NIL</u>
11	Financial Bid Opening Date:	14-12-2017


12 BID EVALUATION REPORT


S#	Name of Firm / Bidder	COST OFFERED BY THE BIDDER	RANKING IN TERMS OF COST	COMPARISON WITH ESTIMATED COST	REASON FOR ACCEPTANCE / REJECTION	REMARKS
1	M/s.S.O.H Construction Co.	Rs.9,39,668/-	1 st Lowest	@0.002% Below	Pay Order and required documents are available. P.O # 18534904 dt:11-12-2017 Rs.20,000/-from HBL Rizvia Society Branch Karachi	Substantially Responsive
2	M/s.AI-Maqbool Associates	Rs.9,40,005/-	2 nd Lowest	@0.034% Above	Pay Order and required documents are available. P.O # 18534922 dt:12-12-2017 Rs.20,000/-from HBL Rizvia Society Branch Karachi	Substantially Responsive


The all concerned bidders are being informed accordingly.

The E.E Concerned for compliance of Rule-45 of SPPRA 2010 **M/s.S.O.H Construction Co.** declared as the lowest responsive bidder by the Committee and recommended for sanction from Competent Authority.


(Muhammad Khalid Khan)
Accounts Officer (Dist. West)
Member / Secretary


(Saif-ul-Haque)
Additional Director Internal
Audit - KMC Member


(Maqsood Ahmed Shaikh)
Superintending Engineer (KMC)
Member


(Muhammad Ali Shaikh)
S.E (District West-B)
Member


(Saifuddin)
Director (Design & Estimate)
Convener

COMPARATIVE STATEMENT

Name of Work: P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF
QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEADABAD BALDIA TOWN

Item No	Description of Work	Estimated Cost				M/s.S.O.H Construction Co.		M/s.Al-Maqb Associates	
		Quantity	Rate	Per	Amount	Rate	Amount	Rate	Amount
1	Dismantling & removing road metalling	1500	605.00	%Cft	9,075.00	605.00	9,075.00	605.00	9,075.00
2	Excavation for pipe line in trenches and pits in all kind of soil of murum i/c trimming and dressing sides to true alignment and shape leveling of beds of trenches to correct level and grade cutting joints holes and disposal of surplus earth within one chain as directed by Engineer Incharge. Providing fence, lights, flags and temporary crossing for non-vehicular traffic wherever required lift upto 5'-0" ft (1.52m) and lead upto one chain (30.5m). 0'-5"	7500	4650.00	%0Cft	34,875.00	4650.00	34,875.00	4650.00	34,875.00
3	P/L & Fixing of Polyethylene pipe in trench i/c fitting jointing and testing etc. complete in all respect the high density Polyethylene P.E pipes (HDPE-100) for W/S conforming ISO 4427/DIN-8074/8075 B.S 3580 & PSI 3051 (PN-10). 10" dia 250 mm	600.00	1267.00	P/Rft	760,200.00	1267.00	760,200.00	1267.00	760,200.00
4	Providing C.I Sluice Valve heavy pattern (Test Pressure 21.0 Kg/sq.com or 300 lb/sq.inch) (Imported) 10" Dia	1.00	27690.00	Each	27,690.00	27690.00	27,690.00	27700.00	27,700.00
5	Fixing of sluice valve with 2 cast iron taji pieces one end flanged & other with socket i/c the cost of nut, bolts & rubber packing, labour etc complete. 10" Dia.	1.00	3319.00	Each	3,319.00	3300.00	3,300.00	3500.00	3,500.00
6	P/F M.S Split Collar on PRCC Pipe of different sizes having width as mentioned against each item to suit the size of connection fabricated with 3/8" thick M.S Plate 1 1/4" wide 3/8" thick ring at centre. 3/4" thick M.S Square Bar on both ends with a total weight as mentioned against each item i/c the cost of 4 Nos 3/4" thick M.S Flanges with a total weight as mentioned against each item. It also includes the cost of nuts and bolts rubber packing, labour and sealing material and all the tools and plants. Net Weight = 104.86 Kg 12" x 12" (2" wide)	1.00	19037.00	Each	19,037.00	19037.00	19,037.00	19100.00	19,100.00

(Handwritten signature)
M₂

(Handwritten signature)


Name of Work: P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF
QUDDOOS MASSJID TO MADINA MASSJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN


Item No	Description of Work	Estimated Cost				M/s.S.O.H Construction Co.		M/s.Al-Maqboo Associates	
		Quantity	Rate	Per	Amount	Rate	Amount	Rate	Amount
7	P/F 0-9" long 3/8" thick M.S Neck to existing M.S Pipe to a split collar tee having a total weight as mentioned against each item. It includes the cost of fabrication and welding to the split collar tee. 10" dia (2.21 Kg)	1.00	No	Each	3,733.00	3,733.00	3,733.00	3,750.00	3,750.00
	4" dia (6.26 Kg)	4.00	Nos	Each	4,916.00	1229.00	4,916.00	1229.00	4,916.00
8	P/F M.S tail piece (DHOLKI) on A.C fabricated with 3/4" thick M.S plate having dimension and weight as mentioned against each item i/c the cost of labour and sealing material etc. 10" dia (Wt. 15.27 Kg)	1.00	No	Each	2,596.00	2,596.00	2,596.00	2,600.00	2,600.00
	4" dia (6.26 Kg)	4.00	Nos	Each	4,392.00	1,098.00	4,392.00	1,098.00	4,392.00
9	Providing /Fixing Split Collar 9" wide on A.C pipe fabricated with 1/4" thick M.S plate, weighting as mentioned against each item. It includes the cost of 4 Nos 1/4" thick flanges, nuts & bolts, rubber packing, labour and sealing material etc complete. 10" dia Net Weight = 14.13 Kg	4.00	Nos	Each	11,200.00	2,800.00	11,200.00	2,800.00	11,200.00
10	Refilling the excavated stuff in trenches 6" thick layer i/c watering ramming to full compaction etc complete.	7173	Cft	%0Cft	19,797.48	2,760.00	19,797.48	2,760.00	19,797.48
11	Full hire charges of pumping set per day i/c of wages of driver and assistant fuel or electric energy platform for placing the pump etc at lower depth with suction and delivery pipes for pumping out water found at various depth from trenches including the cost of erection and dismantling after completion of the job. Hire charges of pumping set upto 10 HP pumping out water from 10' ft deep trench	7.00	Days	P/Day	10,500.00	1,500.00	10,500.00	1,500.00	10,500.00


MS.


Name of Work: P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF
 QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAIEDDABAD BALDIA TOWN


Item No	Description of Work	Estimated Cost				M/s.S.O.H Construction Co.		M/s.Al-Maqbor Associates		
		Quantity	Rate	Per	Amount	Rate	Amount	Rate	Amount	
12	Construction of C.C. block masonry chamber of size 4'x4'x4' deep with 24" x 24" cast and frame weighting 65 kg fixed in RCC 1:2:4 slab 6" thick with steel 1/2" dia tor bar @6" C/C 1/4" betnup 1/4" @ 8" C.C distribution bar 6" thick C.C 1:3:6 block masonry wall set 1:6 C.M 6" C.C 1:4:8 in foundation, 2" thick C.C 1:2:4 flooring, 1/2" thick cement plaster 1:3 ratio inside wall surface top and bottom slab outer side wall surface 1 feet deep upto roof slab M.S foot rest 5/8" bars at every 2 feet deep i/c curing watering excavation refilling and disposal of surplus earth complete.	1.00	No	28357.00	Each	28,357.00	28357.00	28,357.00	28400.00	28,400.00
TOTAL QUOTED / CORRECTED COST						939,687		939,668		940


 (Muhammad Khalid Khan)
 Accounts Officer (Dist. West)
 Member / Secretary


 (Saif-ul-Haque)
 Addl. Director Internal
 Audit KMC - Member


 (Magsood Ahmed Shaikh)
 Superintending Engineer (K.M.C)
 Member


 (Muhammad Ali Shaikh)
 S.E (District West-B)
 Member


 (Saifuddin)
 Director (Design & Estin)
 Convener

OFFICE OF THE CHIEF ENGINEER (W&S) DISTRICT WEST
KARACHI WATER & SEWERAGE BOARD

Room No270, 2nd Floor, Old KBCA Building Behind Civic Centre, Gulshan-e-Iqbal, Karachi.

No. KW&SB/CE(W/S)/AO/WEST/2018/32

Dated: 05-03-18
1/2018

M/S. S.O.H CONSTRUCTION CO.
Karachi.

LETTER OF ACCEPTANCE / SANCTION LETTER

SUBJECT:- P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN

REF:- Your Tender Opened on 14-12-2017.

The under signed is pleased to convey sanction for an amount to **Rs.9,39,668/- (Rupees Nine Lac Thirty Nine Thousand Six Hundred Sixty Eight Only)** for the subjected work under Rule SPPRA-2010, on item rate basis duly assessed by the Procurement/ Evaluation Committee-I KW&SB vide **Para-31/N**, financially concurred-in by finance department, KW&SB vide **Para-43/N to 54/N** and approved by MD, KW&SB vide **Para-56/N** The expenditure is chargeable to **BG No.C-013-17** for the financial year-2017-2018. You shall be bound to abide time to time instruction issued by KW&SB.

You are therefore directed to furnish the Earnest Money amounting to **Rs.18793/-** being amount of 2% of sanction cost of the contract. You are further directed to contact concern Executive Engineer Office for execution of agreement, the value of stamp paper will be **Rs.3289/- @ 0.35%** sanctioned cost which should be produced by you. In case of failure, the sanction shall be stand cancelled and action as per Contractual rules shall be taken against you.

All correspondence onward shall be carried out through Deputy Managing Director (T/S), KW&SB.


DEPUTY-MANAGING DIRECTOR (T/S)
KW&SB

Copy to:-

- 1-DIRECTOR ACCOUNTS, KW&SB.
- 2-ADLFA, KW&SB.
- 3-EE (Water) (BALDIA TOWN), KW&SB.
- 4-OFFICE COPY.

C.C to:-

1. MD, KW&SB.



OFFICE OF THE EXECUTIVE ENGINEER (WATER) BALDIA TOWN
KARACHI WATER & SEWERAGE BOARD

No. KW&SB/E.E/2018/ 67

Dated: 28/03/18

M/S. S.O.H CONSTRUCTION CO.,
Karachi.

WORK ORDER

Subject:- **P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN.**

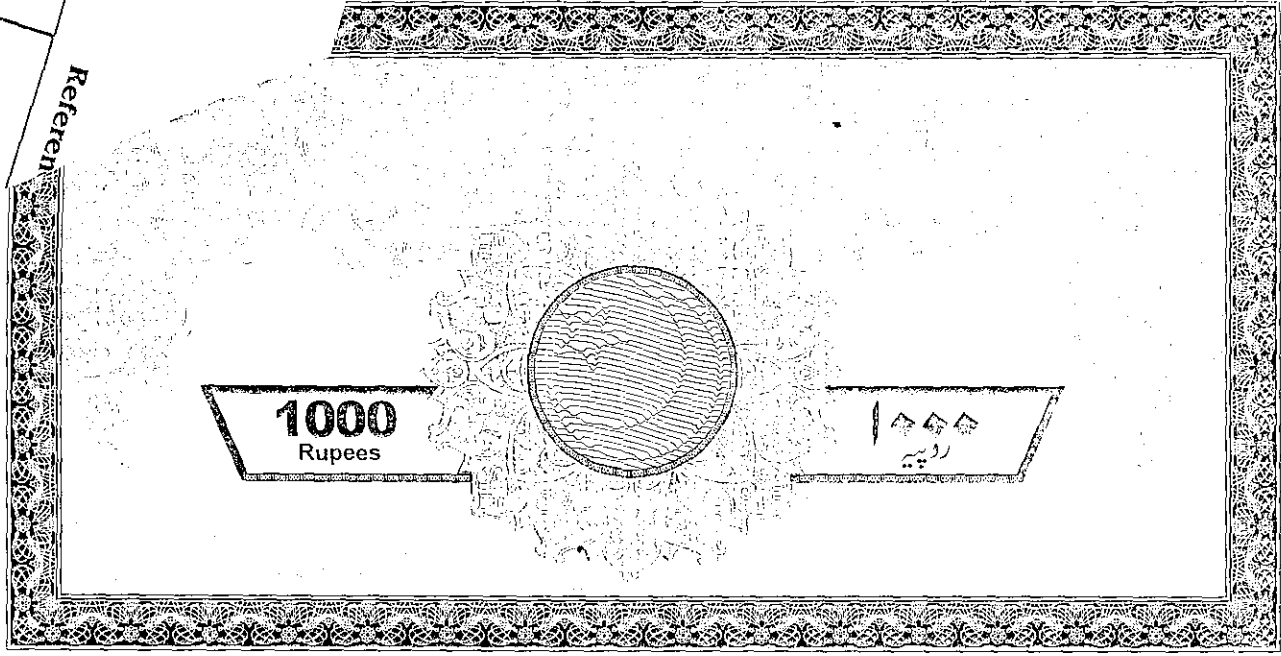
The competent authority KW&SB has been approved amounting to **Rs.939668/- (Rupees Nine Lac Thirty Nine Thousand Six Hundred Sixty Eight Only)** on item rate basis and convey the sanction by Deputy Managing Director (T/S), KW&SB/CE(W/S)/AO/WEST/2018/ 32. Dated: 25-03-2018 under Budget code **No.C-013-17**

You are hereby directed to start the work immediately and **complete the same within 25 days** time commencing from the date of issue of this letter in case the work is delayed or left in-complete within the stipulated time, **penalty of Rs.1000/- per day** shall be imposed as per work rules.


EXECUTIVE ENGINEER (WATER)
BALDIA TOWN, KW&SB

Copy to:-

1-S.E (West), KW&SB.
2-Office Copy



052434

(RUPEES ONE THOUSAND ONLY)

CONTRACT AGREEMENT

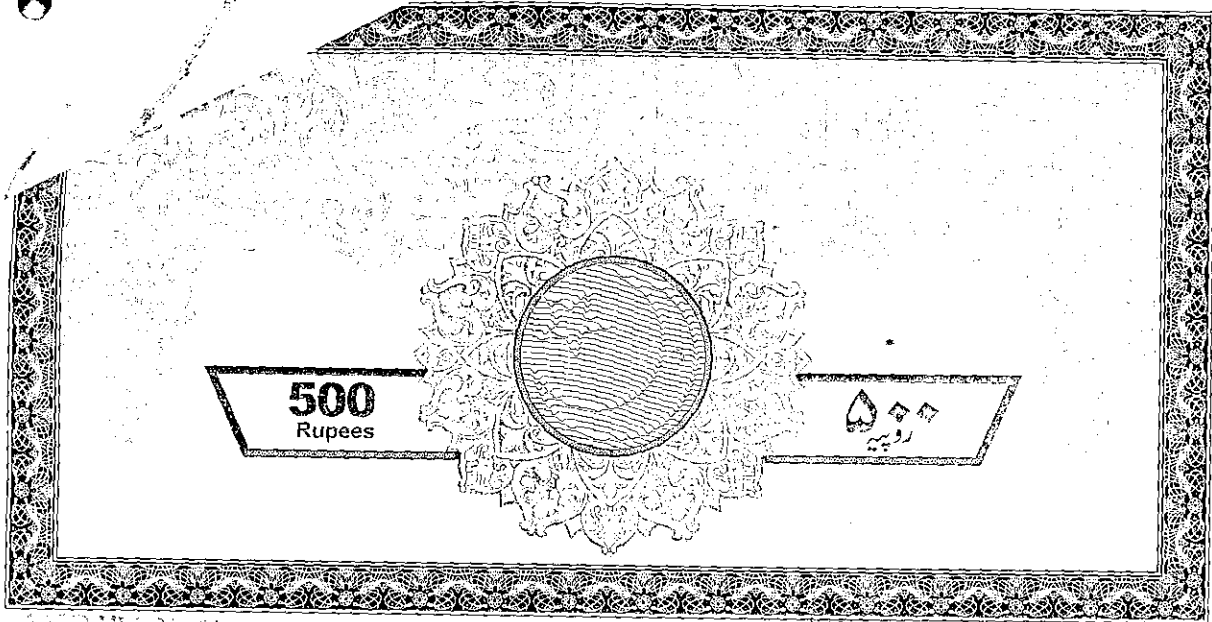
Sanction Amount: Rs. 9,39,668/-

THIS CONTRACT AGREEMENT (hereinafter called the "Agreement") made on the 17/04/18 day of April 2018 between The Karachi Water & Sewerage Board represented by it's The Deputy Managing Director (T/S), KW&SB (hereinafter called the "Employer") of the one part and M/S. S.O.H. CONSTRUCTION CO. (hereinafter called the "Contractor") of the other part.

WHEREAS the Employer is desirous that certain Works, viz **"P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN"** Should be executed by the Contractor and has accepted a Bid by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

NOW This Agreement witnessed as follows:-

1. In this Agreement words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.
2. The following documents after incorporating addenda, if any except those parts relating to Instructions to Bidders, shall be deemed to form and be read and construed as part of this Agreement, viz:
 - (a) The Letter of Sanction
 - (b) The completed Form of Bid along with Schedules to Bid:
 - (c) Conditions of Contract & Contract Data:
 - (d) The priced Schedule of Prices.
 - (e) The Specification: and
 - (f) The Drawings



(RUPEES FIVE HUNDRED ONLY)

023825

Page-2

SUBJECT: P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN

- 3. In consideration of the payments to be made by the Employer to the Contractor as hereinafter mentioned, the Contractor hereby covenants with the Employer to execute and complete the Works and remedy defects therein in conformity and in all respects within the provisions of the Contract.
- 4. The Employer hereby covenants to pay to the Contractor, in consideration of the execution and completion of the Works as per provision of the Contract, the Contract Price or such other sum as may become payable under provisions of the Contract at the times and in the manner prescribed by the Contract.

IN WITNESS WHEREOF, the parties hereto have caused this Contract Agreement to be executed on the day, month and year first before written in accordance with their respective laws.

Signature of the Contractor

[Handwritten Signature]
Proprietor

**M/S. S.O.H CONSTRUCTION CO.
KARACHI**

Signature of Employer

[Handwritten Signature]
**DEPUTY MANAGING DIRECTOR (T/S)
KW&SB**

WITNESS:

1. *[Handwritten Signature]*

[Handwritten Signature]

WITNESS:

[Handwritten Signature]
**SUPERINTENDING ENGINEER (WEST)
KW&SB**

**OFFICE OF THE EXECUTIVE ENGINEER BALDIA TOWN (WATER)
KARACHI WATER & SEWERAGE BOARD**

Estimate amount: - Item Rate basis

Time limit : 25 days

Penalty for delay : 1000/- P/day

Tender Cost : 1000/-

Date of Opening : 14-12-17

NAME OF WORK: **P/L 10" DIA PE PIPE LINE FOR IMPROVEMENT OF WATER SUPPLY OF QUDOOS MASJID TO MADINA MASJID SECTOR NO.5/G AREA SAEEDABAD BALDIA TOWN.**

Description of Work	QTY	Rate		Per Unit / Item	Amount in Rupees
		Rupees in Figures	Rupees in Words		
Dismantling & removing road metalling	1500 Cft	605/2	Six hundred five	%Cft	9075/2
Excavation for pipe line in trenches in all kind of soil & pits i/c trimming and dressing side to true alignment & shapes leveling of beds trenches to correct level and grade, cutting jointing holes and disposal of surplus earth within a one chain as directed by Engineer incharge. Providing fence guards lights, flags, and temporary crossing for non-vehicular traffic. Where ever required lift upto 5ft. (1.52m) and lead upto 1 chain (30.5m). 0-5	7500 Cft	4650/2	Four thousand Six hundred fifty	%Cft	34875/2
Providing Laying & fixing on trench i/c fitting, jointing & testing etc complete in all respect the high density polyethylene PE pipe (HDPE-100) for W/S confirming ISO.4427/din8074/8075 B.S 3580 & PSI 3051 (PN-10). 10" dia 250mm	600 Rft.	1267/2	One thousand two hundred Sixty Seven	P/Rft	760200/
Cl/slucce valve heavy pattern (test pressuer 21.0 kg/sq.com or 300 lbs/sq. inch (imported). 10" dia	01 Nos.	2790/2	Two thousand Seven hundred ninety	Each	27690/
Fixing of S/Valve with two tail pieces one end flange and one end socket with nuts & bolts and rubber packing etc 10" dia	01 Nos.	3300/2	Three thousand three hundred	Each	3300/2
PIF MS Split Collar Tee on PRCC pipe of different sizes having with as mentioned against each item to suit the size of connection fabrication with 3/8" thick MS plate excluding the coast of the neck it includes the cost of 3/8" thick MS square bars on both ends, 4 No. 3/4" thick MS flanges with a total weight as mentioned against each item. It also includes the cost nuts & bolts rubber packing, labour and sealing material and all the tools and plants. Net Weight 104.86 Kgs. 12"x12" (2' Wide)	01 Nos.	19037/2	Nineteen thousand thirty seven	Each	19037/2
PIF 0-9" long 3/8" thick M.S. neck to existing M.S pipe or to split collar tee having a total weight as mentioned against each item i/c the cost of fabrication and welding to the split collar tee 10" dia (21.21 kg) 4" dia (6.56 kg)	01 Nos. 04 Nos.	3733/2 1229/2	Three thousand Seven hundred thirty three One thousand two hundred twenty nine	Each Each	3733/2 4916/2
PIF MS tail piece (DHOLKI) on A/C pipe fabricated with 3/4" thick MS plate having dimensions and weight as mentioned against each item. It i/c the cost of labor and ceiling material etc 10" dia (15.27 kg) 4" dia (6.26 kg)	01 Nos. 04 Nos.	2596/2 1098/2	Two thousand five hundred ninety six One thousand ninety eight	Each Each	2596/2 4392/2
Providing & fixing split collar 9" wide on AC pipe fabricated with 3/4" thick MS Plate weighing as mentioned against each item. It include the cost of 4 Nos. 3/4" thick flanges. Nuts & bolts, rubber packing labour and sealing material etc complete. 10" dia Net Weight = 14.13 Kgs	04 Nos.	2800/2	Two thousand eight hundred	Each	11200/2
Refilling the excavated stuff in trenches 6" thick layer i/c watering raming full compaction etc complete.	7173 Cft	2760/2	Two thousand Seven hundred sixty	%Cft	19797/2
Hire charges of pumping set perday i/c wages of driver and Assistant and or electric energy plate form required for placing pump etc at lower depths with suction and delivery pipes for pumping out water found at various depth from trenches etc. cost of erection and dismantling after completion of the job. (i)Hire charges of pumping set of upto 10 HP pumping out water from 10ft deep trenches.	07 Days	1500/2	One thousand five hundred	P.Day	10500/2
Construction of C/C Block Masonry Chamber of size 4"x4x4" (inside dimension) with 24"x24" CI cover frame weighting 65 Kg in RCC 1:2:4 with 6" thick steel 1/2" dia tor bars main @6" c/c 1/4" dia @8" c/c distribution bars 6" thick c/c 1:3:6 block missionary walls set in 1:0 C.M. 6" thick c/c 1:4:8 in foundation 2" thick c/c 1:2:4 flooring thick cement plaster to all in side walls surface top and bottom slab outer side will surface excavation dewatering refilling etc 4x4x4.	01 Nos.	28357/2	Two thousand Eight hundred thirty five	Each	28357/2

Total Amount Rs. 937668/2 =

Executive Engineer (Water)
Baldia Town, KW&SB

NOTE:- Contractor will abide all existing rules / terms & condition of SPPRA-2010.

We hereby Quoted an Amount of Rs. 937668/2 On item rate basis.

In words (Ninety three thousand Seven hundred Sixty Eight only)

Signature of Contractor

Address: L-631 Sector 5/A/4. Dorch Karachi

Cell No.

0300-2216163

S.O.H. CONST. DIVISION