



GOVERNMENT OF SINDH
COAL & ENERGY DEVELOPMENT DEPARTMENT
UNDERGROUND COAL GASIFICATION PROJECT THAR
ISLAMKOT, DIST: MITHI SINDH



No.UCG/Tender/Elect-182(R)/2014

May 12, 2014

To: **The Director**
Sindh Public Procurement Regulatory Authority,
Government of Sindh,
Karachi.

Subject: **PUBLICATION OF TENDER AT SPPRA WEBSITE**

Kindly find enclosed herewith tender document for hoisting at SPPRA website.
Amount of the tender is below Rs.1 million.

2. Competent Authority has approved the limited tender notice.
3. Submitted for immediate consideration, please.

for Jalwinder
Procurement Officer
UCG Thar Project Site,
C/o Manager,
National Bank of Pakistan
Islamkot.
Ph: 0232-923008
Cell: 0342-1220408
Email: poucgthar@gmail.com



GOVERNMENT OF SINDH
COAL & ENERGY DEVELOPMENT DEPARTMENT
UNDERGROUND COAL GASIFICATION PROJECT THAR
ISLAMKOT, DIST: MITHI SINDH



No.UGC/Tender/Elect-182(R)/2014

May 12, 2014

Tender Documents
LV-ADAPTER PANEL FOR GASIFIER-I

UCG Thar Project is interested to purchase the subject items on FOR UCG Site basis (Islamkot). Details are as per Schedule Annexure-'A' and technical specifications as per Annexure-'B'. Terms and conditions are given below:

01. Blank tender forms can be collected from the Procurement Officer, UCG Project Thar, up to **28-05-2014** during office hours after depositing the tender fee amounting to **Rs.500/- (Non Refundable)** in the shape of pay order in favor of Accounts Officer, UCG Thar Project, Islamkot. Tender documents can also be obtained through email by submitting scanned copy of Bank Draft/ Pay Order however its original should accompany the tender otherwise bid will not be considered.

02. The tenders will be received back up to **29-05-2014 at 1100 Hrs**, Technical offers will be opened at **1500 Hrs** and financial offers will be opened at **1600 Hrs** at the same day, in the presence of Purchase Committee and the bidders or their authorized representatives who wish to be present.

03. The bid package must consist of **two sealed envelopes**:

- First envelope marked: **"UCG/Tender/Elect-182(R)/2014 TECHNICAL OFFER"** should contain the technical documentation and technical specifications with references, statements, literature, drawings, as appropriate. An un-priced financial offer shall be made part of the technical offer.
- Second envelope marked: **"UCG/Elect-182(R)/2014 FINANCIAL OFFER"** should contain a financial offer and 2% of total cost of the bid as earnest money in shape of Bank Draft / Pay Order in favor of Accounts Officer UCG Thar.

Note that:

- **No prices** to be shown in first envelope.
- Second envelope should contain **prices only**, with no reservations.
- Failing to submit two envelopes or omitting any of the requested information will lead automatically to the **rejection of the bid**.
- Envelopes shall be opened in the same sequence as request.
- The evaluation of any company shall not be continued in case they fail to meet the criteria of the envelope requirements.
- Each envelope should be **clearly marked** with the bidder's company name.
- If additional information or technical details are needed, please contact:

Mr. Abdul Manan, Junior Engineer (Electrical)
Underground Coal Gasification Project Thar
Pakistan's. Tel: 92-232 923036
Mob: 0341-3584481
E-mail:ucgthar@gmail.com

04. Bid Security amounting to 2% of Bid Price should be submitted along with the Bid in shape of Pay Order in favor of Accounts Officer, UCG Thar Project, issued by any scheduled Bank of Pakistan.

05. The bid security will be forfeited to the Government, if the bidder withdraws his bid after opening and before the expiry of the bid validity period or fails to sign the contract if the bid is accepted.

06. Amount of the tender is below Rs.1 Million.

07. Conditional tender and tender without bid security shall not be considered.

08. Delivery Time will be 30 days (max.) starting after the issuance of supply order.


09. GST/Income Tax Exemption Certificates, as the case may be, must be accompanied with the tender.

10. Receipt of bid/ tender after due time and date will not be accepted.

12. Only manufacturers or authorized dealers can participate with current/ valid authorization certification.

13. The procuring agency may amend quantities / reject all or any bid at any time prior to the acceptance of a bid or proposal, subject to the relevant provision of SPPRA Rules 2010.

14. Only sealed quotations duly stamped are accepted. Tender envelope should bear the tender No. UCG/Tender/Elect-182(R)/2014 and Tender for LV-ADAPTER PANEL FOR GASIFIER-I.

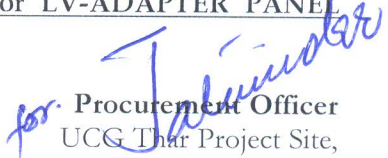for 
Procurement Officer
UCG Thar Project Site,
C/O Manager,
National Bank of Pakistan
Islamkot.
Ph: 0232-923008
Cell: 0342-1220408
Email: poucgthar@gmail.com

SCHEDULE TO TENDER

I/T No.

UCG/Elect-182(R)/2014

1. Time and Date of Technical Bid Opening at 1500hrs on 29-05-2014
 2. Time and Date of Financial Bid Opening at 1600hrs on 29-05-2014

LV ADAPTOR PANEL FOR GASIFIER 1

S.NO	DESCRIPTION	Qty	UNIT	RATE	AMOUNT
E-1	<p>Providing of LV ADAPTER PANEL Floor Standing , Front Access type made of M.S.Sheet using all sorts of circuit breakers from Siemens, ABB, Schneider, GE with proper brass glands complete in all respects and suitable for COUPLING with existing LT Panel having dimensions of Height = 2100 mm, Depth = 800 mm [Copy of the existing LT Panel drawing is attached for working reference] and generally comprising of:</p> <p>a) Sheet Steel Floor mounting cubical structures</p> <p>b) 3 Phase HD HC Copper Bus Bars of 3 X 100 mm X 10 mm size</p> <p>c) 3 Phase HD HC Copper Bus Bars Pieces of 3 X 100 mm X 10 mm size for Coupling with Existing Panel</p> <p>d) Neutral Bus Bar of 1 X 100 mm X 10 mm size + Coupling Pieces</p> <p>e) Earthing Bus Bar of 1 X 60 mm X 10 mm size + Coupling Pieces</p> <p><u>Outgoing</u> 2 X 1000 Amps TP MCCB Adjustable 65 KA</p>	1	Each		
				Total	
				General Sales Tax	
				Grand Total	

Note: Installation at site will be carried out by the Supplier. The quoted price shall be inclusive of Installation Charges.

Technical Specifications

LV Distribution Boards/Panels

The nominal characteristics of the LV Adaptor Panel are ;


- Voltage: 400 Volts AC
- Frequency: 50 Hz
- No. of phases: Three + Neutral + Earth

1. The Enclosure of the Switchgear and its Stand shall be Powder Coated.
2. The switchgear shall form a lineup of freestanding metal enclosures suitable for indoor service. Enclosures shall have adequate strength to withstand all stresses imposed by shipping/ handling, installation and operation without distortion or damage. Provision shall be made for adding cubicles at either end of the switchgear.
3. Hinged doors of framed steel construction, with locks, shall provide access to circuit breaker compartments. The Supplier shall also provide a set of duplicate keys for each panel. Hinged rear door or removable bolted panel shall provide access to bus compartment.
4. The panels shall also provide protection for equipment against:
 - i) Dust
 - ii) Water
 - iii) Insects or rodents
5. Enclosures shall be constructed of smooth finished sheet metal/ with sufficient structural requirement to ensure a plane surface, to limit vibration to provide rigidity.
6. Design, material selection and workmanship shall be such as to result in a neat appearance outside and inside, with no welds, rivets or bolt heads apparent from outside and with all exterior surfaces clean and smooth.
7. The arrangement of equipment shall in no case prevent satisfactory performance/ and shall allow sufficient space for proper maintenance within the structure.
8. The panel front/ top and sides shall be made from minimum 16 SWG thick hot rolled steel plate. Panel frame shall be fabricated from minimum 16 SWG thick steel sheet.
9. Each completed enclosures shall have provision for lifting and handling,
10. The Circuit Breakers will be as specified in Bill of Quantities.
11. MCCB Stands for Moulded Case Circuit Breaker.
12. MCB Stands for Miniature Circuit Breaker.

DISPOSED VIEW

SHED VIEW

DRAWING OF EXISTING LT PANEL
FOR REFERENCE

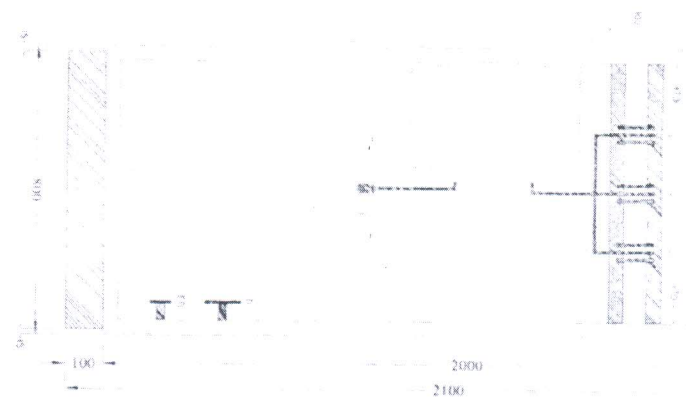

NOTE
INCOMING FROM BOTTOM SIDE
OUTGOING FROM BOTTOM SIDE
TYPE FLOOR MOUNTED
DEPTH 500MM

Signature