


PLAN
STA. 10+500 TO 10+850

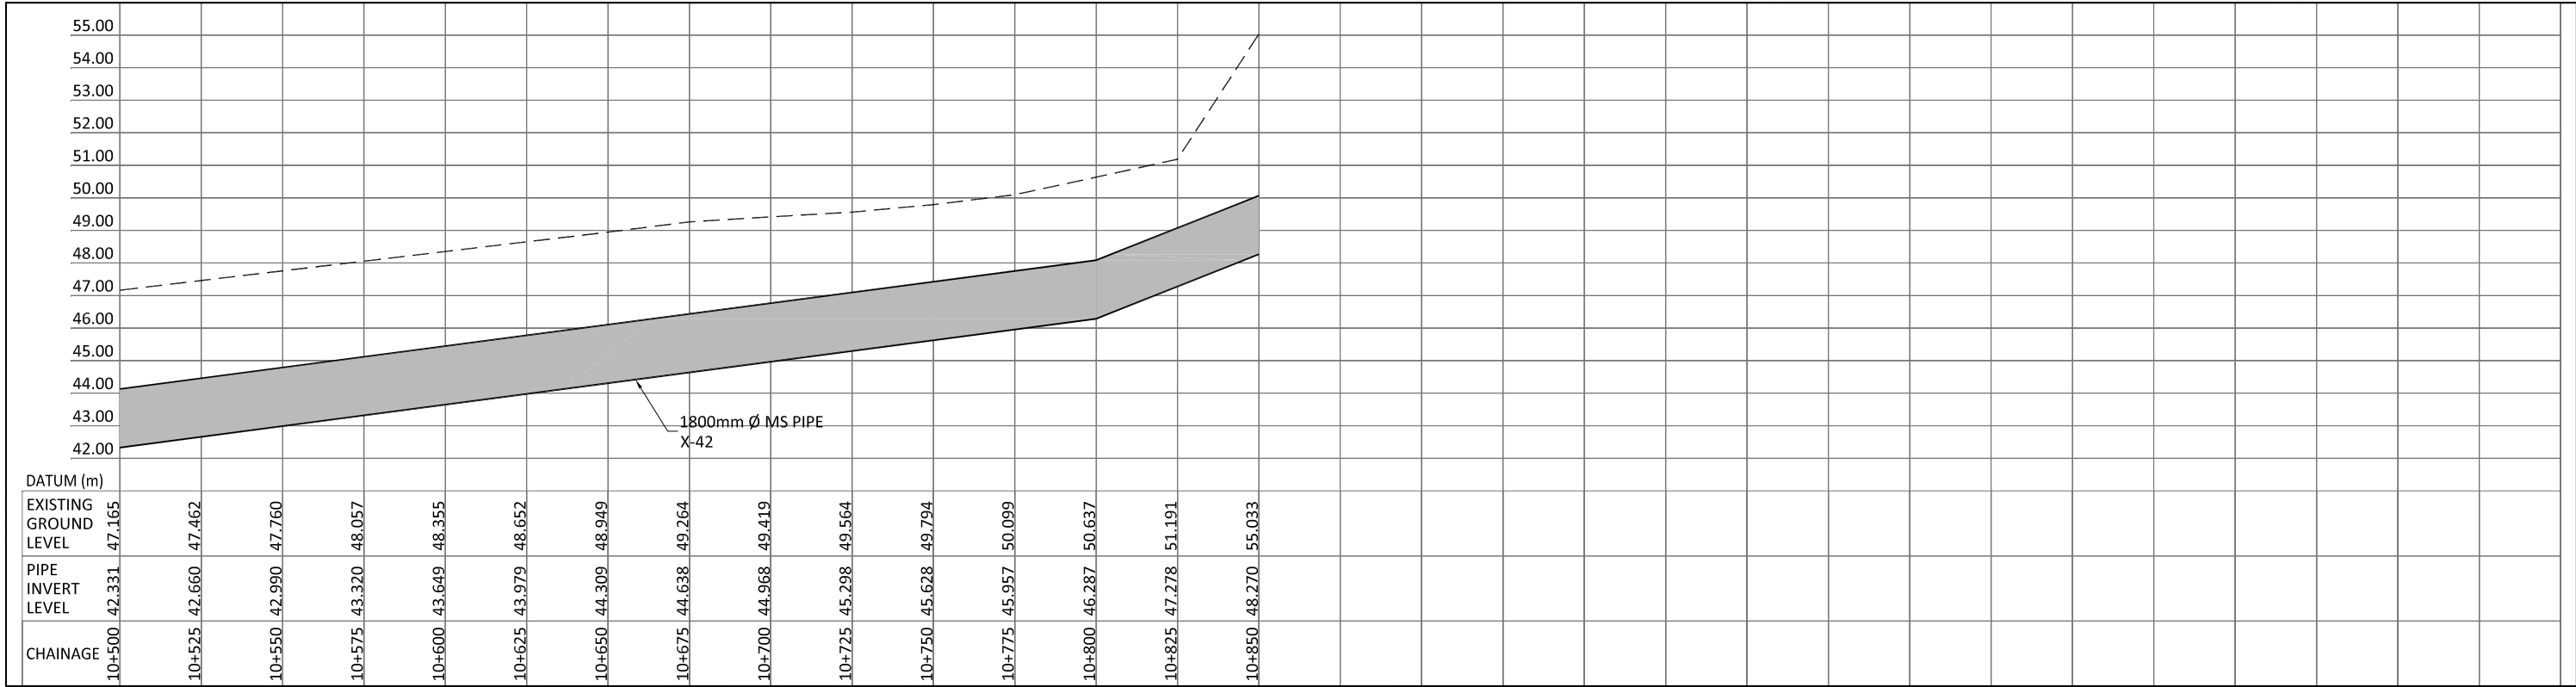

PROFILE
STA. 10+500 TO 10+850

NOTE:-

- ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE STATED.
- MIN COVER SHALL BE OF 2m UNLESS OTHERWISE PIPE SHALL BE ENCASED.
- FOR PIPE TRENCH REFER DWG.NO.EA-942-65M-PIII-U-W400
- FOR THRUST BLOCK REFER DWG.NO.EA-942-65M-PIII-U-W401
- FOR BUTTERFLY VALVE CHAMBER REFER DWG.NO.EA-942-65M-PIII-U-W402
- FOR AIR RELEASE VALVE CHAMBER REFER DWG.NO.EA-942-65M-PIII-U-W403
- FOR WASHOUT VALVE CHAMBER REFER DWG.NO.EA-942-65M-PIII-U-W404
- FOR DETAIL TYPICAL PIPE CROSSING REFER DWG.NO.EA-942-65M-PIII-U-W405
- FOR RAILWAY CROSSING REFER DWG.NO.EA-942-65M-PIII-U-W406
- FOR FOREBAY CHAMBER PLAN REFER DWG.NO.EA-942-65M-PIII-U-W407
- FOR FOREBAY CHAMBER SECTION REFER DWG.NO.EA-942-65M-PIII-U-W408
- 1800mm INNER DIAMETER TO BE PROVIDED WITH 12MM THICKNESS.

LEGEND FOR PLAN:-

PROPOSED PIPE LINE

AIR RELEASE VALVE

WASHOUT VALVE

BUTTERFLY VALVE

EXISTING SERVICES:

WATER LINE

ICI WATER

PORT QASIM WATER

PAKISTAN STEEL WATER

GREATER KARACHI

KARACHI WATER II

KARACHI WATER III

ELECTRIC LINE

SUI SOUTHERN GAS

LEGEND FOR PROFILE:-

NATURAL GROUND

PROPOSED PIPE

AIR RELEASE VALVE

WASHOUT VALVE

BUTTERFLY VALVE

CLIENT:-

KARACHI WATER & SEWERAGE BOARD

CONSULTANT:-

EA Consulting (Pvt.) Limited

IN ASSOCIATION WITH:-

Jers Engineering Consultant

PROJECT:-

ADDITIONAL 65 MGD WATER SUPPLY SCHEME FROM HALEJI TO PIPRI, KARACHI.

| | | | | |
|----------|------------|--------------------------|---|------------------------|
| DRAWN | SAIF | TITLE | PUMPING MAIN MS PIPE Ø 1800mm PLAN & PROFILE (STA = 10+500 TO 10+850) | PACKAGE # 03 |
| DESIGNED | SIDRA | | | |
| CHECKED | MUNAWAR | Scale / Sheet | Drawing No. | EA-942-65M-PIII-U-PP17 |
| APPROVED | ALI ASGHAR | H=1:1000 V=1:100 (A1) | | |

| ED.NO | DATE | DESCRIPTION | BY | CKD | APR |
|-------|--------|-----------------|-------|-----|-----|
| 0 | APR,18 | TENDER DRAWINGS | S.A.S | M.Z | A.A |